


Highest PFOS & PFOA Levels for
NBCMA testing in 2017 including
testing Completed 5/15/2017

	PFOS	PFOA	Combined	LHAL
<u>Well # 1</u>	9	10	19	70
<u>Well # 2</u>	10	13	23	70
<u>Well # 3</u>	8	9	17	70
<u>Well # 4</u>	14	13	27	70
<u>Well # 5</u>	0	0	0	70
<u>Well # 6</u>	0	5	5	70
<u>Well # 7</u>	10	10	20	70
<u>Well # 8</u>	12	11	23	70
<u>Well # 9</u>	9	8	17	70
<u>Well # 10</u>	9	13	22	70
<u>Well # 11</u>	6	8	14	70
<u>Well # 12</u>	7	11	18	70
<u>Well # 13</u>	8	10	18	70
<u>Well # 16</u>	0	4	4	70
<u>Well # 17</u>	8	8	16	70
<u>Antler Dr. PS</u>	0	3	3	70
<u>Bristol Rd. PS</u>	0	3	3	70

Highest level detected



PFOS & PFOA

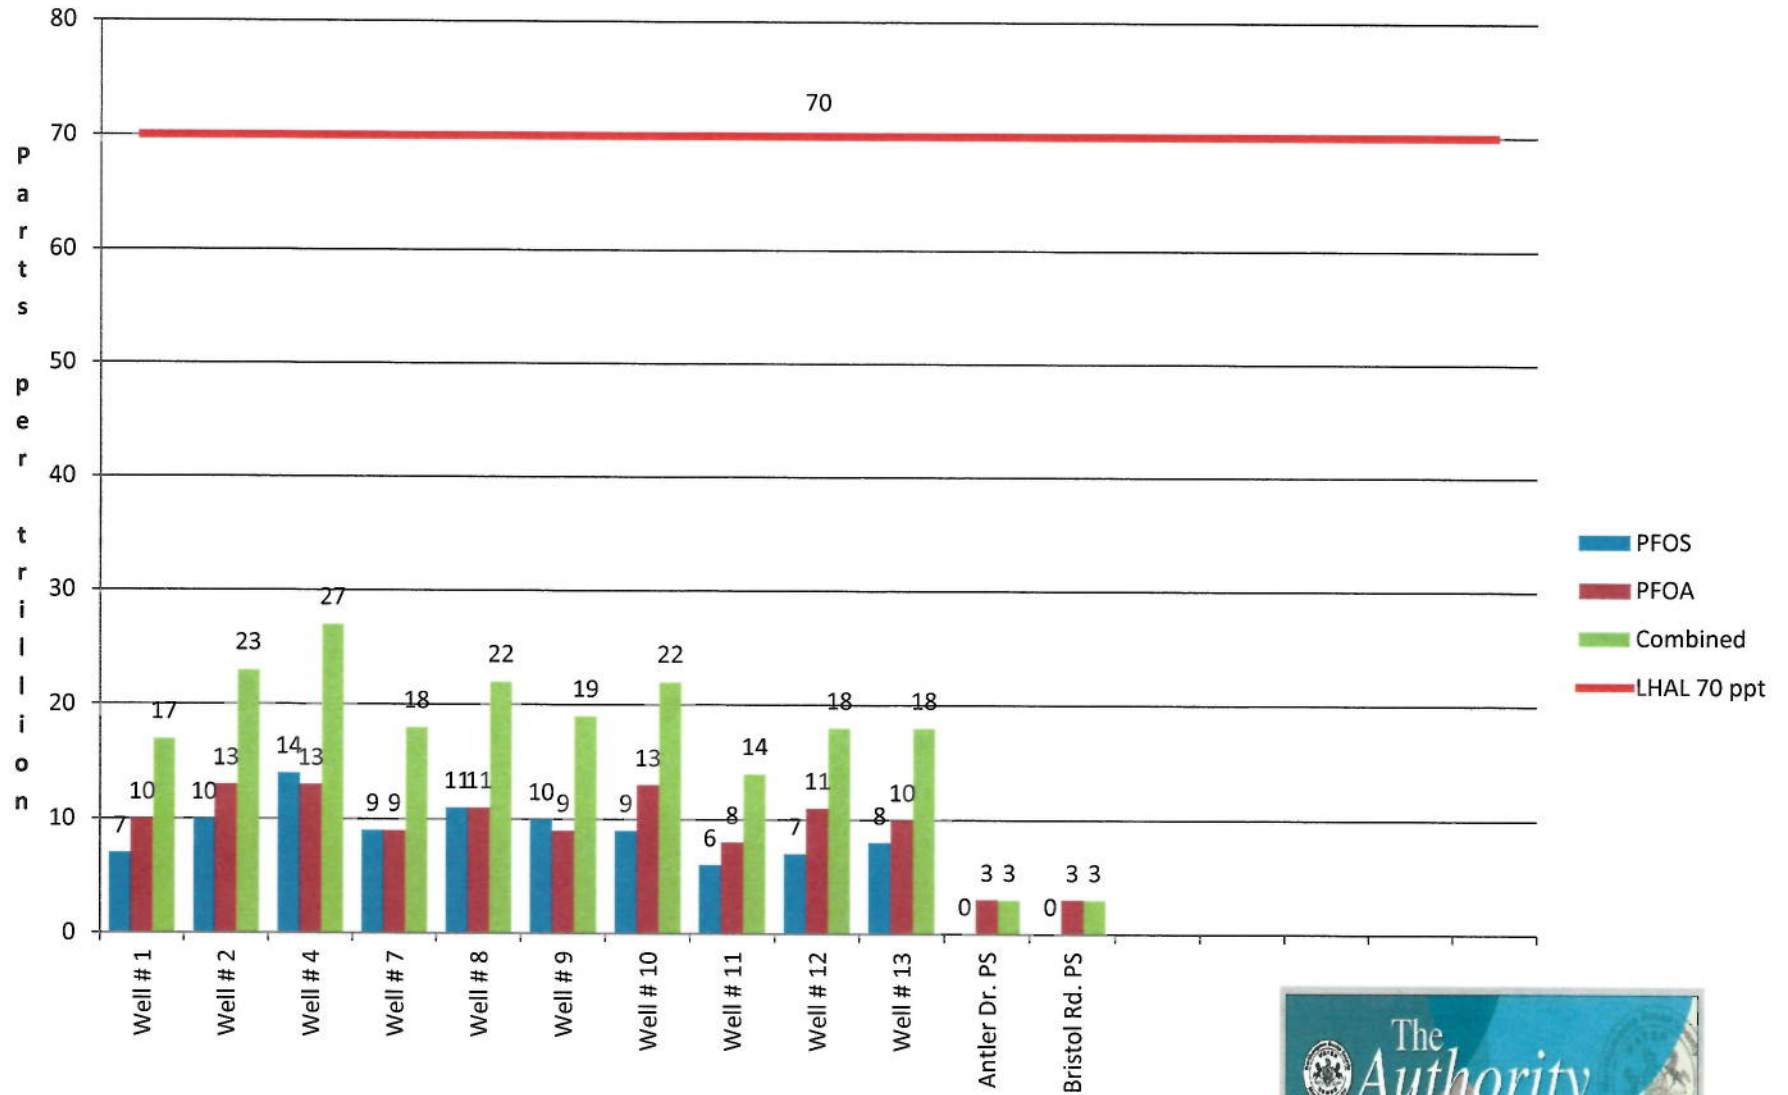

Results For Samples Collect On
5/15/2017

Wells 3,5,6,16 & 17 not tested (offline for CL2 conversion)

