


Maximum PFC Levels NBCMA testing for
2016

	PFOs	PFOA	Combined
<u>Well # 1</u>	8	9	17
<u>Well # 2</u>	12	13	25
<u>Well # 3</u>	8	11	19
<u>Well # 4</u>	14	12	26
<u>Well # 5</u>	0	0	0
<u>Well # 6</u>	0	3	3
<u>Well # 7</u>	9	8	17
<u>Well # 8</u>	12	11	23
<u>Well # 9</u>	9	8	17
<u>Well # 10</u>	8	10	18
<u>Well # 11</u>	7	9	16
<u>Well # 12</u>	6	10	16
<u>Well # 13</u>	7	7	14
<u>Well # 16</u>	4	7	11
<u>Well # 17</u>	8	11	18
<u>Antler Dr. PS</u>	0	2	2
<u>Bristol Rd. PS</u>	0	2	2

Highest level detected

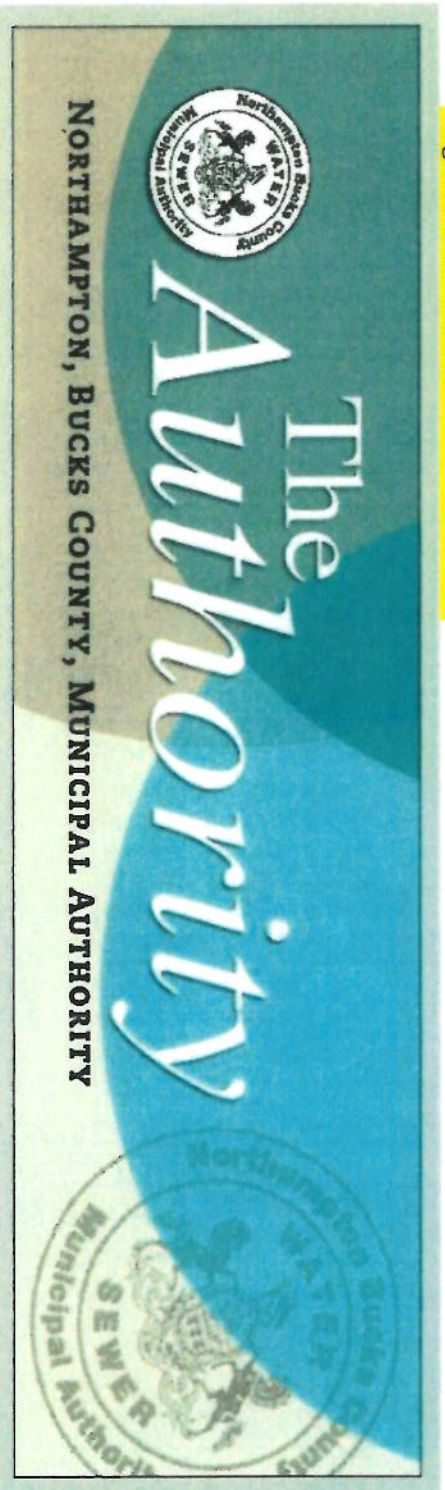

Maximum Levels

